
ENERGY AND AUTOMATION

P1RD4P40AC030 RESIDUAL CURRENT OPERATED CIRCUIT BREAKER, 4 MODULES, 4P - TYPE AC, 40A, 30MA



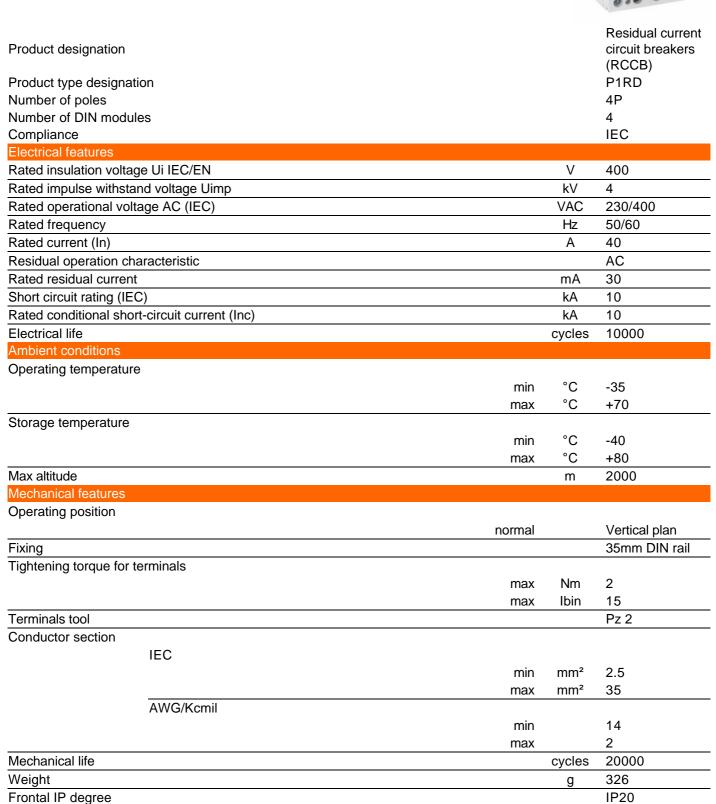


Pollution degree


2



Dimensions

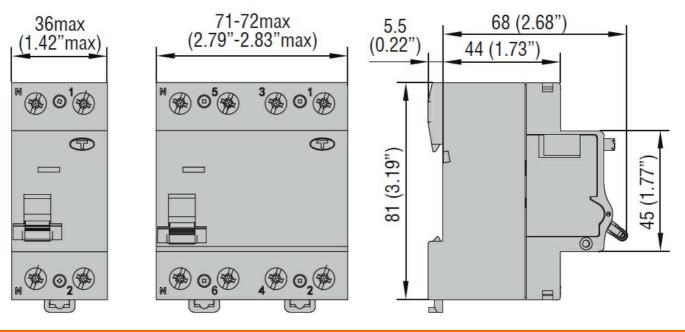

Wiring diagrams

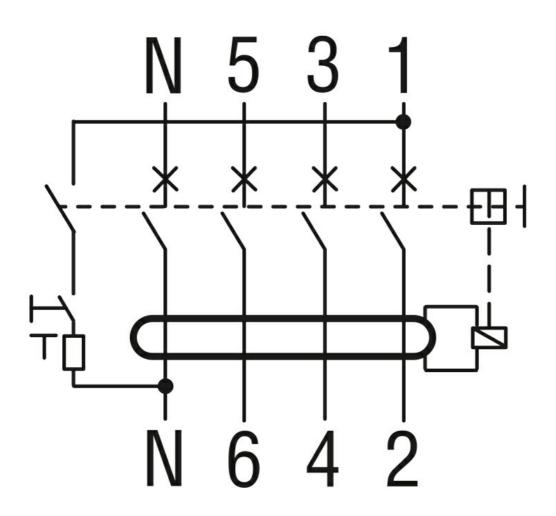

Certifications and compliance Compliance



P1RD4P40AC030 RESIDUAL CURRENT OPERATED CIRCUIT BREAKER, 4 MODULES, 4P - TYPE AC, 40A, 30MA

	IEC/EN/BS 61008-1	
Certifications		
	EAC	
	TÜV-Rheinland	
ETIM classification		
		EC000003 -
ETIM 8.0		Residual current
21110 0.0		circuit breaker
		(RCCB)